




Operator  
Telephone  
Fax  
e-Mail

## Кота 6,20-Канцелария Краезнание / Single Sheet Output

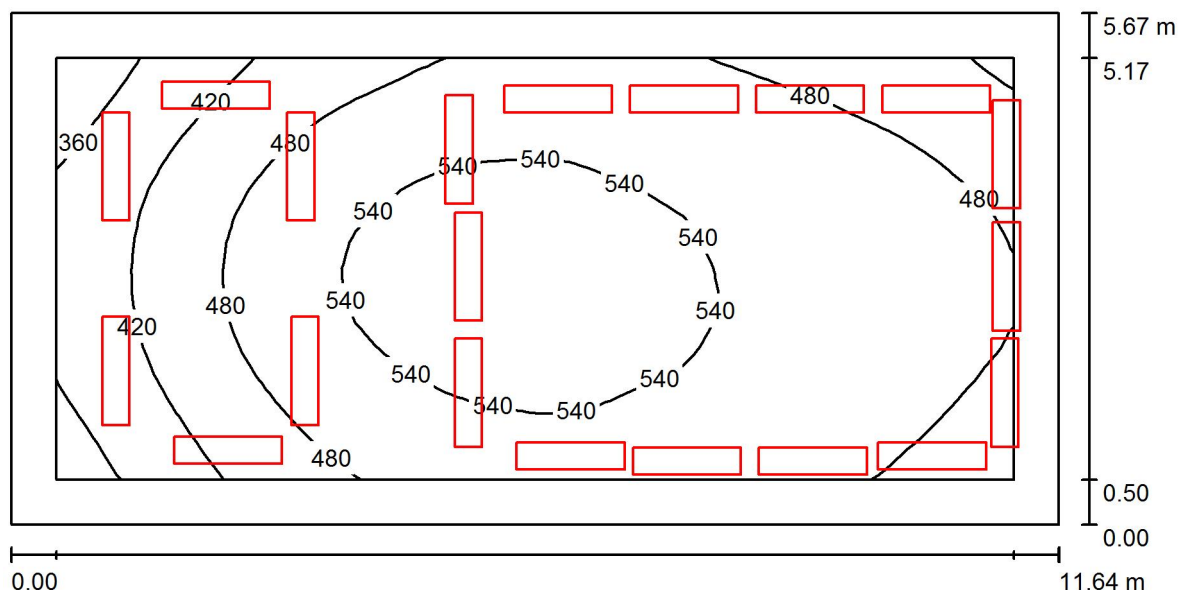

Height of Room: 4.850 m, Mounting Height: 4.850 m, Maintenance factor: 0.80

Values in Lux, Scale 1:84

Surface	$\rho$ [%]	$E_{av}$ [lx]	$E_{min}$ [lx]	$E_{max}$ [lx]	$u_0$
Workplane	/	494	322	572	0.652
Floor	20	421	251	511	0.598
Ceiling	70	147	93	254	0.632
Walls (4)	50	331	116	945	/

### Workplane:

Height: 0.750 m  
Grid: 32 x 16 Points  
Boundary Zone: 0.500 m

Illuminance Quotient (according to LG7): Walls / Working Plane: 0.706, Ceiling / Working Plane: 0.297.

### Luminaire Parts List

No.	Pieces	Designation (Correction Factor)	$\Phi$ (Luminaire) [lm]	$\Phi$ (Lamps) [lm]	P [W]
1	20	OCTA-LIGHT PLC OCTL_PNL_12030-36NW-7-230-20 (1.000)	3397	3400	36.0
Total:			67946	68000	720.0

Specific connected load:  $10.90 \text{ W/m}^2 = 2.21 \text{ W/m}^2/100 \text{ lx}$  (Ground area:  $66.06 \text{ m}^2$ )