




Operator  
Telephone  
Fax  
e-Mail

## Кота +1,20-Библиотека / Single Sheet Output

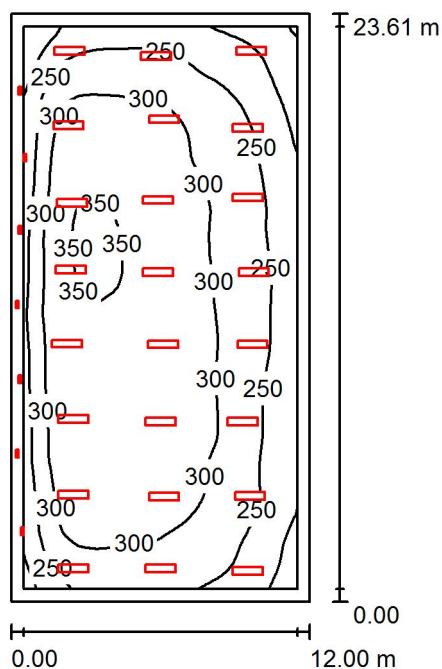

Height of Room: 5.500 m, Maintenance factor: 0.90

Values in Lux, Scale 1:304

Surface	$\rho$ [%]	$E_{av}$ [lx]	$E_{min}$ [lx]	$E_{max}$ [lx]	$u_0$
Workplane	/	286	146	358	0.509
Floor	20	257	127	334	0.495
Ceiling	70	92	47	166	0.506
Walls (4)	50	144	49	308	/

### Workplane:

Height: 0.750 m  
Grid: 64 x 128 Points  
Boundary Zone: 0.500 m

Illuminance Quotient (according to LG7): Walls / Working Plane: 0.500, Ceiling / Working Plane: 0.322.

### Luminaire Parts List

No.	Pieces	Designation (Correction Factor)	$\Phi$ (Luminaire) [lm]	$\Phi$ (Lamps) [lm]	P [W]
1	31	OCTA-LIGHT PLC OCTL_PNL_12030-36NW-7-230-20 (1.000)	3397	3400	36.0
Total:			105316	105400	1116.0

Specific connected load:  $3.94 \text{ W/m}^2 = 1.38 \text{ W/m}^2/100 \text{ lx}$  (Ground area:  $283.32 \text{ m}^2$ )